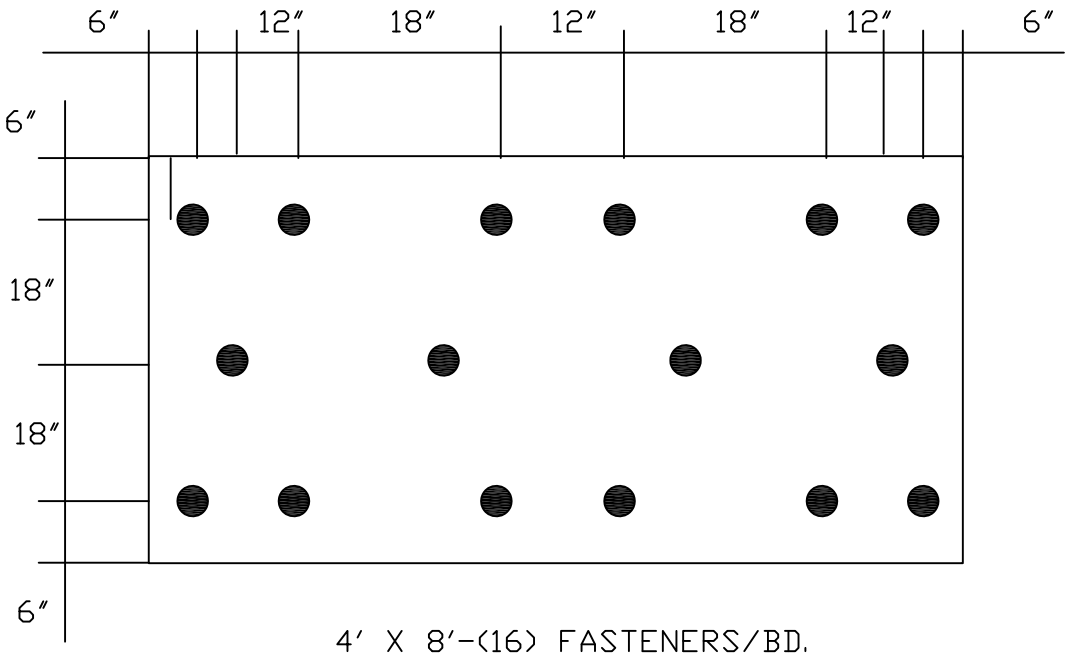

4′ X 8′-(16) FASTENERS/BD.

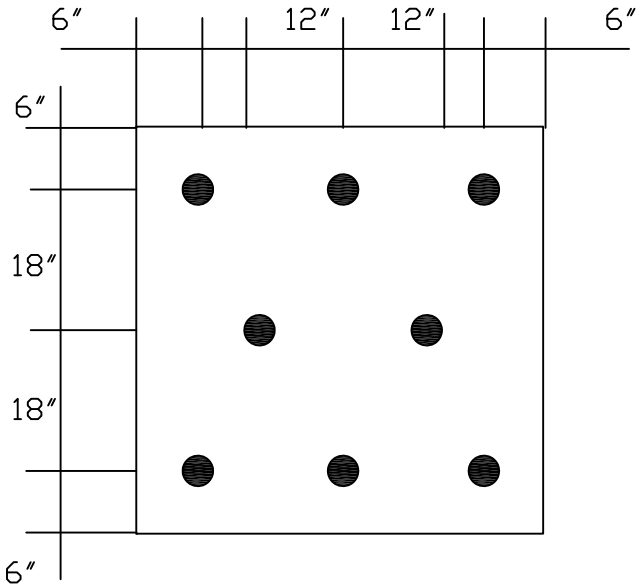

4′ X 4′-(8) FASTENERS/BD.

NOTES:

1) MINIMUM THICKNESS OF INSULATION SHALL BE 1.3″ to 1.4″
2) SEE FACTORY MUTUAL APPROVAL GUIDE FOR APPROVED FASTENERS/PLATES
3) FM 1-90 FASTENING PATTERN
4) REFER TO LOSS PREVENTION DATA SHEET 1-29 OR CONSULT THE ROOF SYSTEM MANAFACTURER FOR PERIMETER AND CORNER ENHANCEMENT RECOMMENDATIONS.

TITLE	FLEX ISO II, FLEX ISO III
NAME	DETAIL NO. FLEX ADHERED 2
DRAWN BY: KF	DATE: 07/2007
APPLICABLE TO FLEX	
ADHERED SYSTEMS	
FLEX MEMBRANE INTERNATIONAL	2670 LEISCZ'S BRIDGE RD. LEESPORT, PA 19533 800-969-0108 www.flexmembranes.com